

HOME SIZE	MAX. ROOF LIVE LOAD (PSF)	MAX. WIND LOAD (MPH, EXP)	30 PSF		30 PSF		40 PSF		100 PSF		100 PSF		
			85B	85C	100B	100C	100C	100C					
SINGLES	4:12	10'-16'	UP TO 48'	4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	
			48.5'-60'	6 3 ROWS	4 6 3 ROWS	4 6 3 ROWS	4 6 3 ROWS	4 6 3 ROWS	4 6 3 ROWS	4 6 3 ROWS	4 6 3 ROWS	4 6 3 ROWS	4 6 3 ROWS
	3:12	20'-23.5'	UP TO 66'	8 2 ROWS	0 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS	4 4 2 ROWS
			66.5'-68'	12 3 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS
			68.5'-70'	12 3 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS
			70.5'-72'	12 3 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS
DOUBLE WIDES	4:12	20'-26'	UP TO 56'	8 2 ROWS	0 4 2 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	
			56.5'-68'	8 2 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS
	3:12	24'-32'	UP TO 56'	8 2 ROWS	0 8 2 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	
			56.5'-68'	12 3 ROWS	0 12 3 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS
TRIPLE WIDES	4:12	26.5'-32'	UP TO 56'	8 2 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 10 4 ROWS	4 10 4 ROWS	4 10 4 ROWS	4 10 4 ROWS	
			56.5'-68'	12 3 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 8 3 ROWS	4 10 4 ROWS	4 10 4 ROWS	4 10 4 ROWS	4 10 4 ROWS	4 10 4 ROWS	
	3:12	30'-40'	UP TO 48'	8 2 ROWS	0 8 2 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	
			48.5'-60'	12 3 ROWS	0 12 3 ROWS	0 8 3 ROWS	4 8 3 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	
4:12	40.5'-48'	UP TO 48'	12 3 ROWS	0 12 3 ROWS	0 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 16 5 ROWS	4 16 5 ROWS	4 16 5 ROWS		
		48.5'-60'	12 3 ROWS	0 12 3 ROWS	0 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 12 4 ROWS	4 16 5 ROWS	4 16 5 ROWS	4 16 5 ROWS		

TABLE NOTES:
TO USE TABLE, FIND HOME SIZE (SINGLE, DOUBLE OR TRIPLE), THEN FIND ROOF PITCH, WIDTH AND LENGTH. FOLLOW ROW ACROSS TO DESIGN SNOW LOAD THEN DESIGN WIND LOAD. READ TOTAL NUMBER OF C.P. SEISMIC PIERS, # OF ROWS & C.P. ANCHOR PIER TIEDOWNS. LAYOUT SHOWN IN DOUBLE WIDE PLAN VIEW ABOVE.


FOR EXAMPLE, FOR A 24'x60' HOME WITH A 3:12 ROOF PITCH, DESIGN SNOW LOAD OF 30 PSF & 85 MPH EXPOSURE C WIND LOAD, READ 12 C.P. SEISMIC PIERS, PLACED IN 3 ROWS, WITH 0 C.P. ANCHOR PIER TIEDOWNS. LAYOUT SHOWN IN DOUBLE WIDE PLAN VIEW ABOVE.

*FOR SINGLE WIDES, WHERE TIEDOWN COLUMN IS SPLIT AS SHOWN, INSTALL 2 EARTH ANCHOR TIEDOWNS AT EACH ENDWALL. TOTAL # OF ENDWALL TIEDOWNS PER HOME IS INDICATED IN TABLE BY *.

HOME SIZES REFER TO NOMINAL SIZES THAT ARE COMMONLY MANUFACTURED. IF THE EXACT SIZE OF THE HOME IS NOT LISTED, CHECK THE NEXT HIGHER OR LOWER SIZE AND USE THE ONE THAT REQUIRED MORE PIERS.

THE TIEDOWNS SHALL BE LISTED & INSTALLATION INSTRUCTIONS SHALL BE ON SITE AT TIME OF INSPECTION.

NO MORE THAN 1/3 OF THE TOTAL NUMBER OF C.P. SEISMIC PIERS MAY BE EXTENDED ABOVE 22.75 INCHES MEASURED FROM THE BASE OF THE PIER TO THE TOP PLATE OF THE PIER. NO MORE THAN 1/2 OF THE C.P. ANCHOR PIER MAY BE EXTENDED ABOVE 29 INCHES MEASURED AS STATED ABOVE.

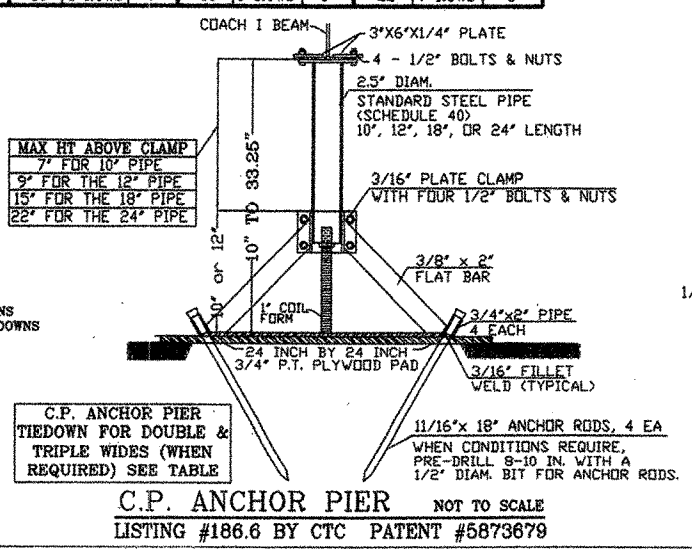

STATE APPROVAL

MANUFACTURED HOME/MOBILE HOME FOUNDATION SYSTEM HEALTH AND SAFETY CODE, SECTION 18551 APPROVED

SUBJECT TO CORRECTIONS NOTED


APPROVAL DOES NOT AUTHORIZE OR APPROVE ANY OMISSIONS OR DEVIATION FROM REQUIREMENTS OF APPLICABLE STATE LAWS AND REGULATIONS

State of California
Department of Housing and Community Development

DIVISION OF CODES AND STANDARDS

APPROVED DATE 4/19/2008

SPR NO. 30-258 (signature)
This Plan Approval Expires 4/19/2010

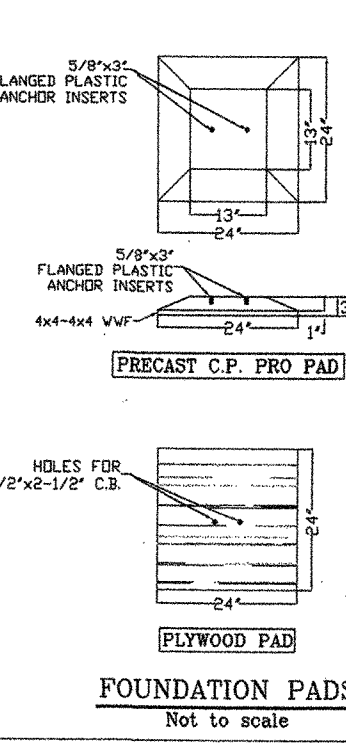

GENERAL NOTES:
REFERENCE: CALIFORNIA CODE OF REGULATIONS, TITLE 25 AND C.B.C. 2007, CHAPTER 16.

- DESIGN LOADS SHALL BE CONSISTENT WITH LOCAL REQUIREMENTS WHERE INSTALLED. THE FOLLOWING DESIGN LOADS ARE INCORPORATED HEREIN:
FLOOR LIVE LOAD: 40 PSF ROOF LIVE LOAD: 30PSF - 100 PSF AS LISTED IN TABLE
SEISMIC DESIGN CATEGORY: D BASIC WIND SPEED & EXPOSURE: 85-100MPH AS LISTED IN TABLE
SITE CLASS D Sd=1.5 Sds=1.4 Fv=1.4 V=0.216W
- FOOTINGS ARE TO BE SUPPORTED BY EITHER FIRM, UNSATURATED, UNDISTURBED SOIL OR COMPACTED FILL ASPHALT OR CONCRETE. FOOTINGS ARE DESIGNED FOR 1000 PSF BEARING CAPACITY AND SHALL BE COMPATIBLE WITH LOCAL SOIL CONDITIONS. ALL FOOTINGS SHALL BE FOUNDED IN ACCORDANCE WITH H.C.D. GUIDELINES AND TITLE 25 OR PREPARE SUBGRADE PER SOIL REPORT, WHEN AVAILABLE.
- STRUCTURAL STEEL:
a. SHALL CONFORM TO ASTM A36 Fy = 36 KSI MINIMUM.
b. SHALL BE FABRICATED ACCORDING TO AISI SPECIFICATIONS.
c. SHALL BE WELDED ACCORDING TO AWS SPECIFICATIONS:
i. ELECTRODES: E70
ii. PLATES: ASTM A36
iii. BOLTS: STANDARD ASTM A307
iv. THREADED ROD: COLD DRAWN LOW CARBON WELDABLE
d. ALL METAL COMPONENTS INCLUDING NAILS & SCREWS ETC. ARE TO BE PROTECTIVE COATED.
- THE C.P. SEISMIC PIER SHALL BE LISTED & LABELED BY BSK ASSOCIATES FOR THESE ULTIMATE LOADS:
A. 7" THRU 18 INCH PIERS: 3203 LBS. (STRONG DIR), 2273 (WEAK DIR), 16,000 VERTICAL
B. 19 INCH X-LARGE PIER: 1553 LBS. (STRONG DIR), 1462 (WEAK DIR), 16,000 VERTICAL
- THIS FOUNDATION SYSTEM IS FOR PLACING MANUFACTURED HOMES CONSTRUCTED WITH LONGITUDINAL OR CROSS JOISTS.
- THIS FOUNDATION SYSTEM IS DESIGNED TO BE CONSTRUCTED ON A FAIRLY LEVEL SITE WITH NO EXISTING SOIL PROBLEMS. SEE NOTE 2 AND TITLE 25, SECTION 1334(b).
- THE SIZE, TYPE & LOCATION OF STANDARD VERTICAL SUPPORT PIERS & FOOTINGS MUST BE INSTALLED PER THE HOME MANUFACTURER'S INSTALLATION MANUAL. WITHOUT MANUAL, SPACING OF STANDARD PIERS TO BE DETERMINED BY TITLE 25, SECTION 1335.5.

FOUNDATION PAD NOTES:


- TWO FOUNDATION PADS ARE AVAILABLE FOR USE WITH THIS SYSTEM. THE CUSTOMER MAY CHOOSE ONE OF THE PADS FOR THEIR HOME.
- FOUN PADS SHALL BE PLACED ON FIRM, LEVEL UNDISTURBED SOIL (SEE GEN. NOTE 2)
- THE FOUNDATION PADS SHALL BE ORIENTED AS SHOWN ON THE PLAN VIEW DRAWING WITH THE BOLT HOLES PERPENDICULAR TO THE CHASSIS BEAM. SEE PLAN VIEW.
- CONCRETE FOUNDATION PADS
A. 2500 PSI AT 28 DAYS AS TESTED AND MANUF. BY STARLITE WEIGHT CONCRETE.
- PRESSURE TREATED FOUNDATION PAD
A. 3/4 INCH A.P.A. 48/24 EXTERIOR P.S.I.-83 CC. PLUGGED, NER-QA397,PRP-108.
- ATTACHMENT TO EXISTING CONCRETE SLAB
THE C.P. SEISMIC PIER MAY BE ATTACHED TO AN EXISTING COMPETENT CONCRETE SLAB OR CONCRETE FOOTING ACCORDING TO THE FOLLOWING CRITERIA:
1. ATTACH WITH TWO 1/2" DIAM. ITW RAMSAY/ REDHEAD TRUBULT WEDGE ANCHORS
2. MINIMUM EMBEDMENT = 2.5"
3. MINIMUM CONCRETE THICKNESS = 3 3/4"
4. MINIMUM EDGE DISTANCE = 2"

COACH SIZE NOTES:

- UNLESS APPROVED BY ROCK SOLID ENGINEERING, INC., THE ROOF PITCH SHOULD NOT EXCEED:
A. SINGLE WIDES: 4:12
B. DOUBLE AND TRIPLE WIDES: 3:12 OR 4:12 AS LISTED IN TABLE

INSPECTION REQUIREMENTS:

- THE DESIGN OF THIS SYSTEM IS BASED ON STANDARD MANUFACTURED HOMES AS BUILT BY THE MANUFACTURER. SITE BUILT ADDITIONS SUCH AS GARAGES AND SECONDARY ROOFS HAVE NOT BEEN INCLUDED IN THIS DESIGN.
- ALL DIMENSIONS INCLUDED ON THIS PLAN, INCLUDING COACH SIZE, ROOF HEIGHT AND PIER HEIGHT, SHOULD BE FIELD VERIFIED BY THE LOCAL BUILDING OFFICIAL. ANY DISCREPANCIES SHOULD BE IMMEDIATELY BROUGHT TO THE ENGINEER'S ATTENTION.
- THE BUILDING PAD SHOULD BE INSPECTED TO ENSURE THAT PROPER SOIL CONDITIONS AND DRAINAGE PATTERNS HAVE BEEN ESTABLISHED IN ACCORDANCE WITH TITLE 25 & THE HOME INSTALLATION MANUAL.

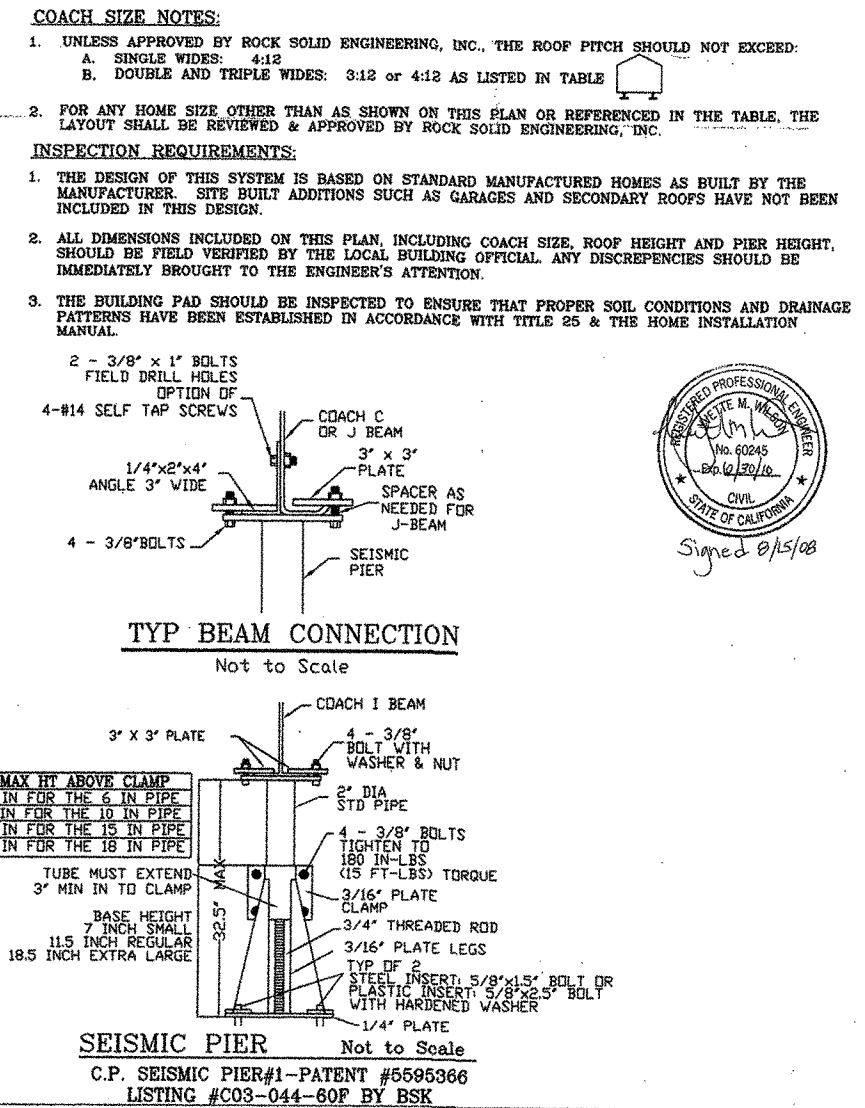

REVISIONS BY

ROCK SOLID ENGINEERING, INC.
CIVIL & GEOTECHNICAL CONSULTANTS
Foundation Engineering • Site Assessments • Manufactured Home Foundations • Expert Witness

1100 MAIN STREET, SUITE A, WATSONVILLE, CA. 95076 (831) 724-5868

FOR: CENTRAL PIERS, INC.
284 N. THORNE
FRESNO, CA. 93706
(559) 268-0828

ENGINEERED FOUNDATION SYSTEM: C.P. SEISMIC 32.5"

DATE: 08-13-08
SCALE: AS SHOWN
DRAWN: YMW
JOB #: W03002
SHEET: 1
OF 1 SHEETS